resideo Pressure Reducing Valve



Pressure Reducing Valve

with balanced seat and set point scale

APPLICATION

According EN 806-2 pressure reducing valves of this type protect household water installations against excessive pressure from the supply. They can also be used for industrial or commercial applications within the range of their specification.

By installing a pressure reducing valve, pressurisation damage is avoided and water consumption is reduced.

The set pressure is also maintained constant, even when there is wide inlet pressure fluctuation.

Reduction of the operating pressure and maintaining it at a constant level minimizes flow noise in the installation.

APPROVALS

- DVGW
- WRAS (up to 23 °C)

SPECIAL FEATURES

- Inlet pressure balancing no influence on outlet pressure by fluctuating inlet pressure
- Up to size 1¹/₄" approved by LGA for low noise, Group 1 without limitations
- The valve insert is of high-quality synthetic material and can be fully exchanged
- The outlet pressure is set by turning the adjustment knoh
- The set pressure is directly indicated on the set point scale
- The adjustment spring is not in contact with the drinking water
- Integral fine filter
- Also available without fittings
- Conforms to BSEN 1567
- All materials are UBA conform
- ACS certified






TECHNICAL DATA

Media			
Medium:	Drinking water		
Connections/Sizes			
Connection sizes:	1/2" - 2"		
Nominal sizes:	DN15 - DN50		
Pressure values			
Max. inlet pressure with clear	16 bar		
filter bowl:			
Max. inlet pressure with	25 bar		
brass filter bow:			
Outlet pressure:	1.5 - 6 bar		
Preset outlet pressure:	3 bar		
Min. pressure drop:	1 bar		
Operating temperatures			
Max. operating temperature	70 °C		
medium (10 bar/brass filter			
bowl):			
Max. operating temperature	30 °C		
medium accord. to EN 1567:			

Note: Use the SMO6T brass filter bowl, if the valve can be exposed to

UV radiation or solvent vapors.

CONSTRUCTION

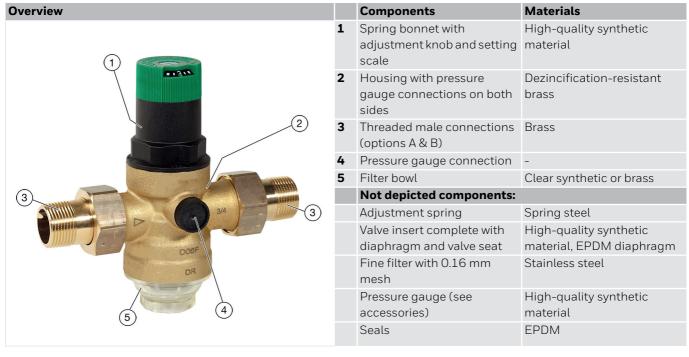

METHOD OF OPERATION

Spring loaded pressure reducing valves operate by means of a force equalising system. The force of a diaphragm operates against the force of an adjustment spring. If the outlet pressure and therefore diaphragm force fall because water is drawn, the then greater force of the spring causes the valve to open. The outlet pressure then increases until the forces between the diaphragm and the spring are equal again.

The inlet pressure has no influence in either opening or closing of the valve. Because of this, inlet pressure fluctuation does not influence the outlet pressure, thus providing inlet pressure balancing.

TRANSPORTATION AND STORAGE

Keep parts in their original packaging and unpack them shortly before use.

The following parameters apply during transportation and storage:

Parameter	Value
Environment:	clean, dry and dust free
Min. ambient temperature:	5°C
Max. ambient temperature:	55 °C
Min. ambient relative humidity:	25 % *
Max. ambient relative humidity:	85 % *

^{*}non condensing

INSTALLATION GUIDELINES

Setup requirements

- Install in horizontal pipework with filter bowl downwards
- Install shut-off valves
- The device downstream should be protected by means of a safety valve (installed downstream of the pressure reducing valve). In these cases the delivery pressure of the pressure reducing valve shall be set to at least 20% below the response pressure of the pressure reliefvalve according to EN 806-2
- The installation location should be protected against frost and be easily accessible
 - Pressure gauge can be read off easily
 - With clear filter bowl, degree of contamination can be easily seen
 - Simplified maintenance and cleaning
- Install downstream of the filter or strainer
- Provide a straight section of pipework of at least five times the nominal valve size after the pressure reducing valve (in accordance with EN 806-2)
- Requires regular maintenance in accordance with EN 806-5

Installation Example

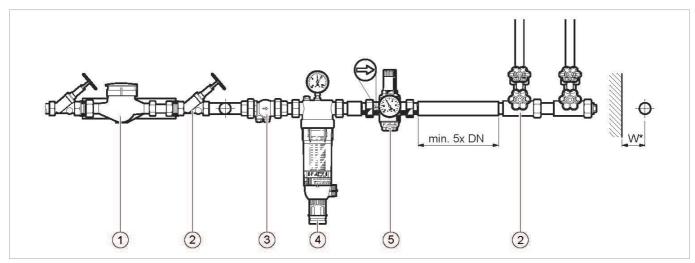


Fig. 1 Standard installation example for the pressure reducing valve

- 1 Water meter
- 2 Shut-off valve
- 3 Check valve
- 4 Filtering unit
- 5 Pressure reducing valve

Connection sizes:						
DN:	15	20	25	32	40	50
inch:	1/2"	3/4"	1"	11/4"	11/2"	2"
Distance in mm (W*):	55	60	60	60	70	70

^{*} Required installation distances between the centerline of the pipework and the surrounding in dependency of the connection size.

TECHNICAL CHARACTERISTICS

kvs-Values

Connection sizes:	15	20	25	32	40	50
k_{vs} -value (m^3/h):	2.4	3.1	5.8	5.9	12.6	12.0
IfBt designation:	P-IX 1582/I	P-IX 1582/I	P-IX 1582/I	P-IX 1582/I	- *	- *
DVGW registration number:	DW-6330 AT 2314					

^{*} Compulsory testing in sizes R $^1\!/_2$ " to R 1 $^1\!/_4$

Pressure drop characteristics


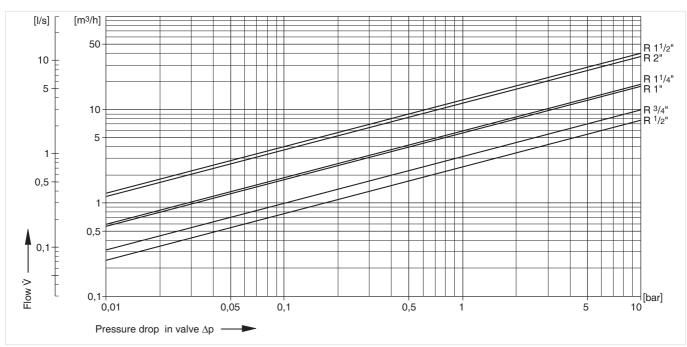


Fig. 2 Pressure drop within the valve in dependency of the flow rate and the used connection size

DIMENSIONS

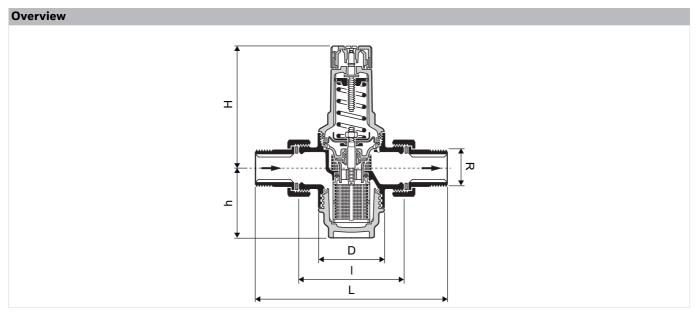

Parameter	Values						
Connection sizes:	R	1/2"	3/4"	1"	11/4"	11/2"	2"
Nominal size diameter:	DN	15	20	25	32	40	50
Weight:	kg	0.8	1.0	1.4	2.0	3.3	4.5
Dimensions:	L	140	160	180	200	225	255
	- 1	80	90	100	105	130	140
	Н	89	89	111	111	173	173
	h	58	58	64	64	126	126
	D	54	54	61	61	82	82

Note: All dimensions in mm unless stated otherwise.

ORDERING INFORMATION

The following tables contain all the information you need to make an order of an item of your choice. When ordering, please always state the type, the ordering or the part number.

Options

The valve is available in the following sizes: $^1\!/_2$ ", $^3\!/_4$ ", 1 ", $1^1\!/_4$ ", $1^1\!/_2$ " and 2 ".

- standard
- not available

		D06FA	D06FB	D06FE
Max. operating	40 °C	•	-	•
temperature medium:	70 °C	-	•	-
Filter bowl:	clear	•	-	•
	brass	-	•	-
31	external threaded connection set on in- and outlet	•	•	-
	external thread on in- and outlet	-	-	•

Note: ... = space holder for connection size

Note: Ordering number example for $1^{1}/4$ " and type A valve: D06F-11/4A

Accessories

	Descripti	on	Dimension	Part No.				
	М07М	Pressure gauge						
		Housing diameter 63 mm, rear connection thre	ad G ¹ /4"					
2 8-		Range: 0 - 4 bar		M07M-A4				
		Range: 0 - 10 bar		M07M-A10				
10 1121		Range: 0 - 16 bar		M07M-A16				
		Range: 0 - 25 bar		M07M-A25				
	ZR06K	Double ring wrench						
		For removal of spring bonnet and filter bowl						
				ZR06K				
	VST06A	Connection set						
		Threaded connections						
			1/2"	VST06-1/2A				
			3/4"	VST06-3/4A				
			1"	VST06-1A				
			11/4"	VST06-11/4A				
			$1^{1}/_{2}$ "	VST06-11/2A				
			2"	VST06-2A				
b	VST06B	Connection set						
		Solder connections						
			1/2"	VST06-1/2B				
			3/4"	VST06-3/4B				
			1"	VST06-1B				
			11/4"	VST06-11/4B				
			11/2"	VST06-11/2B				
			2"	VST06-2B				

Spare Parts

Pressure Reducing Valve D06F, from 1997 onwards

Overview		Description	Dimension	Part No.
		Spring bonnet complet		
1			¹ / ₂ " - 1"	0901515
			1" + 11/4"	0901516
			$1^{1}/_{2}$ " + 2"	0901518
	2	Valve insert complete (
			1/2" + 3/4"	D06FA-1/2
			1" + 1/4"	D06FA-1B
8			$1^{1}/_{2}" + 2"$	D06FA-11/2
	3	Union seal washer (10 p		
			1/2"	0901443
			3/4"	0901444
			1"	0901445
			11/4"	0901446
			11/2"	0901447
			2"	0901448
	4			
3			1/2" + 3/4"	0901246
			1" + 11/4"	0901499
8			$1^{1}/_{2}$ " + 2"	0901248
	5	Clear filter bowl with O	-ring	
2			1/2" + 3/4"	SK06T-1/2
			1" + 11/4"	SK06T-1B
(7)			$1^{1}/_{2}$ " + 2"	SK06T-11/2
	6	Brass filter bowl with O		
			1/2" + 3/4"	SM06T-1/2
(5)(6)			$1" + 1^{1}/4"$	SM06T-1B
			$1^{1}/_{2}" + 2"$	SM06T-11/2
	7	Replacement filter inse		
			1/2" + 3/4"	ES06F-1/2A
			$1" + 1^{1}/_{4}"$	ES06F-1B
			$1^{1}/_{2}" + 2"$	ES06F-11/2A
	8	Blanking plug with O-ri	ng R ¹ /4" (5 pc	s.)
			1/2" - 2"	S06K-1/4



Ademco 1 GmbH, Hardhofweg 40, 74821 MOSBACH, GERMANY

Phone: +49 6261 810 Fax: +49 6261 81309